





Install Guide & Tips – **SCAB-MC** – Metal Conduit Penetration

Safti-Seal Penetration Fire Stop


“Static” metal pipe or conduit penetrating “Dynamic” Head of Wall joint designed to deflect with Overhead Structure. To maintain a continuous smoke, sound, and fire rated assembly around penetration, through Safti-Seal FRG, and independent of gypsum wall sheathing:

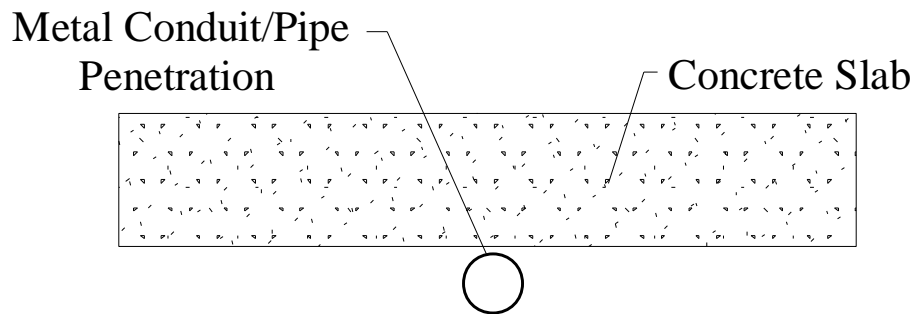

- 1) Terminate Ceiling Runner or Track flanges a max 1 ½” from edge of penetrant on both sides of wall assembly

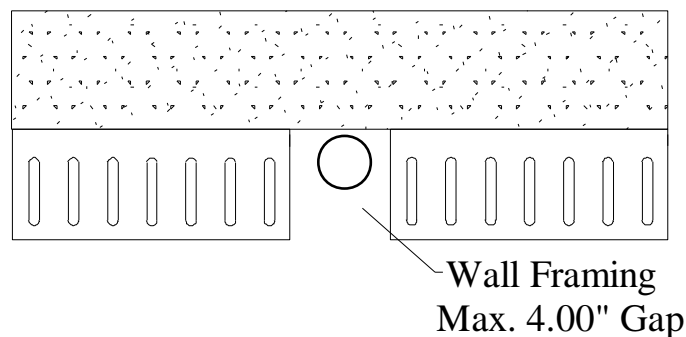


- 2) Install Safti-Seal SCAB-MC around metal penetrant with the “sealant support collar” located in wall cavity friction fitting the ½” horizontal leg of SCAB-MC Profile between ceiling runner and overhead structure overlapping runner flanges a min 1 ½” on both ends

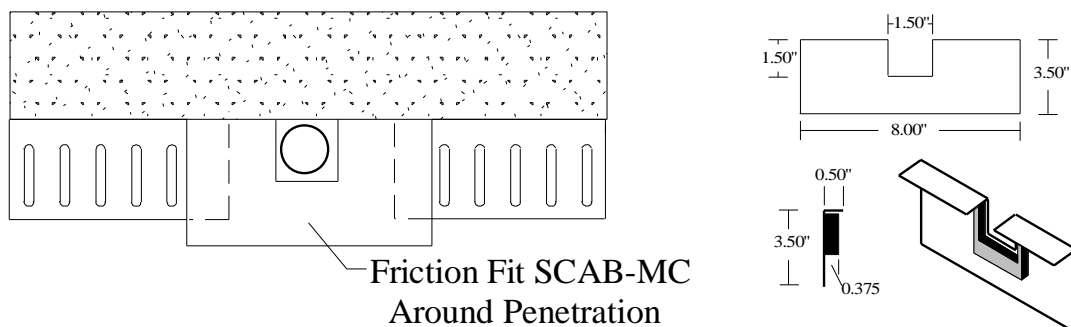




Install Guide & Tips – **SCAB-MC** – Metal Conduit Penetration

- 3) Apply MC-150+ per UL listing filling annular space around penetrant in foam sealant support collar

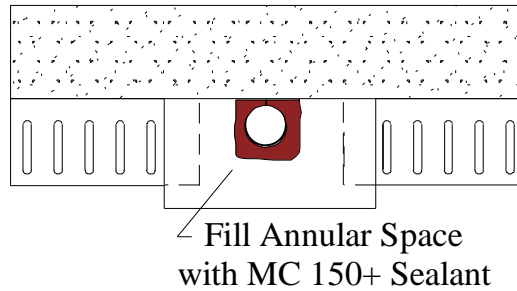

- 4) Install appropriate Safti-Seal FRG gasket (sized to accommodate required deflection/protection) along track flange, around, and below penetrant opening of SCAB-MC profile

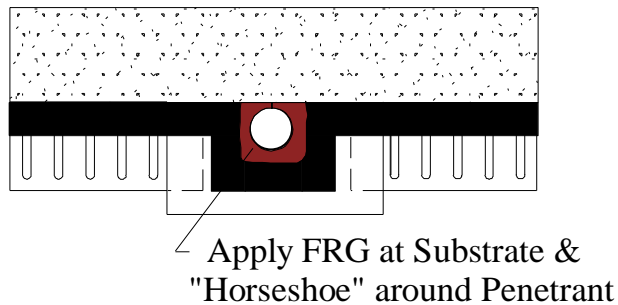

- 5) Install gypsum contour or square cut around penetrant to allow for 100% movement with appropriate horizontal and vertical overlap of Safti-Seal FRG gasket and accommodating Sealant around penetrant

