



SOUND TRANSMISSION LOSS TEST REPORT NO. TL17-289

CLIENT: Safti-Seal Inc.
5806 119th Ave SE Suite A, #381
Bellevue, WA 98006
TEST DATE: 12 May 2017

1 June 2017

INTRODUCTION

The test was performed in accordance with ASTM E 90-09 (2016), Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and ASTM E2235-04(2012), Standard Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods. Copies of the test standard are available at www.astm.org. The test chamber source and receiving room volumes are 204 and 148.4 cubic meters respectively. Western Electro-Acoustic Laboratory is accredited by the United States Department of Commerce, National Institute of Standards and Technology under the National Voluntary Accreditation Program (NVLAP) Lab Code 100256-0 for this test procedure. This test report relates only to the item(s) tested. This report must not be used to claim product certification, approval, or endorsement by WEAL, NVLAP, NIST or any agency of the federal government.

DESCRIPTION OF TEST SPECIMEN

The test specimen was a wall assembly constructed from metal studs and Type X gypsum board. The following components were used in the construction of the specimen:

- USG Type X gypsum board, R-13 fiberglass insulation, 20 and 25 Gauge metal track and studs, and Safti-Seal composite intumescent Strip.

TEST Configuration

Table with 3 columns: Source Side, Stud, Receive Side. Source Side: 16 mm (5/8 inch) USG Type X 2 layers. Stud: 25 gauge metal with R-13 faced fiberglass insulation. Receive Side: 16 mm (5/8 inch) USG Type X

- The studs were 92.1 mm (3-5/8 inch) 25 ga metal studs and were spaced at 609.6 mm (24 inches) O.C. The top track was 20ga metal slotted profile 92.1 mm (3-5/8 inch) with 63.5 mm (2 1/2 inch) long flanges and 38.1 mm (1 1/2 inch) slots 25.4 mm (1 inch) O.C. on both flanges. The sill track was 92.1 mm (3-5/8 inch) 25ga metal with 31.75 mm (1 1/4 inch) flanges. All track and edge studs were screwed directly to the test chamber opening 609.6 mm (24 inches) O.C.
On the source room side:
Two layers of 15.9 mm (5/8 inch) thick type X gypsum boards were screwed to the studs at 203.2 mm (8 inches) O.C. around the perimeter and 304.8 mm (12 inches) O.C in the field using 41.3 mm (1-5/8 inch) drywall screws. All gypsum was oriented vertically and the joints were staggered between layers on both sides of the wall.
On the receive room side:
A layer of 15.9 mm (5/8 inch) thick type X gypsum board was screwed to the studs at 203.2 mm (8 inches) O.C. around the perimeter and 304.8 mm (12 inches) O.C in the field using 41.3 mm (1-5/8 inch) drywall screws. The gypsum was oriented vertically.
On both sides:
At the head of wall a minimum 12.7 mm (1/2 inch) gap was left above the gypsum board on both sides. For this test, the top gaps on both sides were intentionally left open to expose Safti-Seal composite Safti-Strip joint protection applied to top track.



SOUND TRANSMISSION LOSS TEST REPORT NO. TL17-289

CLIENT: **Safti-Seal Inc**
5806 119th Ave SE Suite A, #381
Bellevue, WA 98006

1 June 2017
Page 2 of 3

TEST DATE: 12 May 2017

On both sides, the vertical joints, vertical edges, and sill joints were sealed with a bead of acoustical caulk and covered with foil tape. All screw heads were covered with metal foil tape. The overall dimensions of the wall assembly were 2.44 m (96 inches) wide by 2.44 m (96 inches) high by 155.6 mm (6-1/8 inches) thick. The overall weight of the assembly was estimated to be 139 kg (321 lbs) for a calculated surface density of 24.5 kg/m² (5.01 lbs/ft²)

RESULTS OF THE MEASUREMENTS

One-third octave band sound transmission loss values are plotted and tabulated on the attached sheet. ASTM minimum volume requirements are met at 80 Hz and above. The Outdoor-Indoor Transmission Class rating determined in accordance with ASTM E 1332-10a was OITC-38. The Sound Transmission Class rating determined in accordance with ASTM E 413-10 was STC-51.

Approved:

Respectfully submitted,
Western Electro-Acoustic Laboratory


Stephen A. Martin, Ph.D., P.E.
Laboratory Director

Raul Martinez
Acoustical Test Technician

WESTERN ELECTRO-ACOUSTIC LABORATORY

Report No. TL17-289

Page 3 of 3

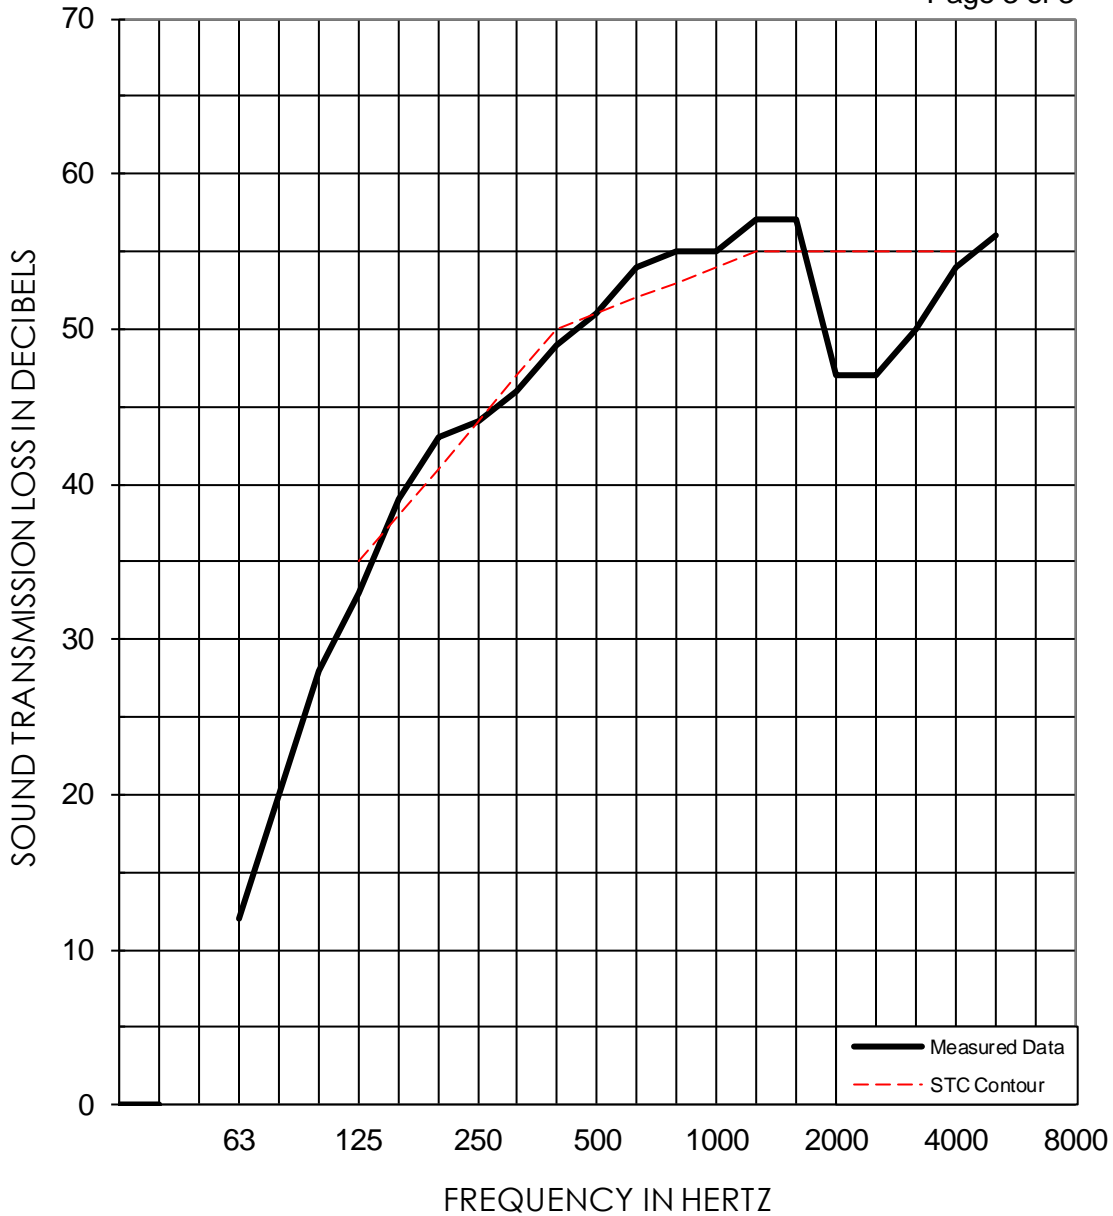

1/3 OCT BAND CNTR FREQ	63	80	100	125	160	200	250	315	400	500
TL in dB	12	20	28	33	39	43	44	46	49	51
95% Confidence in dB deficiencies	1.42	1.92	2.07	1.47	0.89	0.76	0.80	0.52	0.36	0.38
				(2)			(0)	(1)	(1)	(0)
1/3 OCT BAND CNTR FREQ	630	800	1000	1250	1600	2000	2500	3150	4000	5000
TL in dB	54	55	55	57	57	47	47	50	54	56
95% Confidence in dB deficiencies	0.29	0.44	0.38	0.39	0.36	0.56	0.55	0.31	0.32	0.50
						(8)	(8)	(5)	(1)	

EWR	OITC	Test Date: 12 May 2017	STC
52	38	Specimen Area: 64 sq.ft.	
		Temperature: 72.5 deg. F	
		Relative Humidity: 45 %	
			51 (26)